MOUNTING AND OPERATING INSTRUCTIONS



EB 2549 EN

Translation of original instructions



Type 2422/2425 Excess Pressure Valve

Self-operated Pressure Regulators

Note on these mounting and operating instructions

These mounting and operating instructions assist you in mounting and operating the device safely. The instructions are binding for handling SAMSON devices. The images shown in these instructions are for illustration purposes only. The actual product may vary.

- ➔ For the safe and proper use of these instructions, read them carefully and keep them for later reference.
- → If you have any questions about these instructions, contact SAMSON's After-sales Service (aftersalesservice@samsongroup.com).



Documents relating to the device, such as the mounting and operating instructions, are available on our website at **www.samsongroup.com** > **Downloads** > **Documentation**.

Definition of signal words

Hazardous situations which, if not avoided, will result in death or serious injury

Hazardous situations which, if not avoided, could result in death or serious injury

Property damage message or malfunction

i Note

Additional information

∹∑- Tip

Recommended action

| 1 | General safety instructions | .4 |
|-----|--|----|
| 2 | Process medium and scope of application | .5 |
| 2.1 | Transportation and storage | |
| 3 | Design and principle of operation | .6 |
| 4 | Installation | .8 |
| 4.1 | Assembly | .8 |
| 4.2 | Mounting orientation | .9 |
| 4.3 | Notes on installation | .9 |
| 4.4 | Control line, compensation chamber and needle valve1 | 0 |
| 4.5 | Strainers1 | |
| 4.6 | Shut-off valve1 | |
| 4.7 | Pressure gauge1 | 1 |
| 5 | Operation 1 | 2 |
| 5.1 | Start-up1 | 2 |
| 5.2 | Adjusting the set point1 | 2 |
| 5.3 | Decommissioning1 | 3 |
| 6 | Maintenance and troubleshooting1 | 3 |
| 6.1 | Replacing the operating diaphragm1 | 3 |
| 7 | Nameplate | 4 |
| 7.1 | Nameplates1 | 4 |
| 7.2 | Location of the nameplates1 | 5 |
| 7.3 | Material identification number1 | 5 |
| 8 | After-sales service | 5 |
| 9 | Disposal1 | 6 |
| 10 | Dimensions1 | 7 |
| 11 | Technical data 1 | 9 |
| 12 | Certificates | 20 |



General safety instructions

- The device must be mounted, started up or serviced by fully trained and qualified personnel only; the accepted industry codes and practices are to be observed. Make sure employees or third parties are not exposed to any danger.
- All safety instructions and warnings given in these mounting and operating instructions, particularly those concerning installation, start-up, and maintenance, must be strictly observed.
- According to these mounting and operating instructions, trained personnel refers to individuals who are able to judge the work they are assigned to and recognize possible dangers due to their specialized training, their knowledge and experience as well as their knowledge of the applicable standards.
- The regulators comply with the requirements of the European Pressure Equipment Directive 2014/68/EU and the Machinery Directive 2006/42/EC.
 Regulators with a CE marking have a declaration of conformity which includes information about the applied conformity assessment procedure. The declaration of conformity is included in the 'Certificates' chapter.
- To ensure appropriate use, only use the device in applications where the operating pressure and temperatures do not exceed the specifications used for sizing the device at the ordering stage.
- The manufacturer does not assume any responsibility for damage caused by external forces or any other external factors.
- Any hazards that could be caused in the regulator by the process medium, operating pressure or by moving parts are to be prevented by taking appropriate precautions.
- Proper transport, storage, installation, operation, and maintenance are assumed.

i Note

According to the ignition risk assessment performed in accordance with Clause 5.2 of ISO 80079-36, the non-electrical actuators and valves do not have their own potential ignition source even in the rare incident of an operating fault. As a result, they do not fall within the scope of Directive 2014/34/EU (ATEX). For connection to the equipotential bonding system, observe the requirements specified in Clause 6.4 of EN 60079-14 (VDE 0165-1).

2 Process medium and scope of application

Pressure regulator for liquids, gases and vapors up to 350 $^\circ\mathrm{C}$

For controlling the upstream pressure p_1 to the adjusted set point. The valve opens when the upstream pressure rises. The upstream pressure is transmitted to the actuator over a control line that must be installed on site.

The pressure regulators are not shut-off devices guaranteeing tight shut-off. When closed, these regulators can have a leakage rate of ≤ 0.05 % of the K_{VS} coefficient.

Overpressure protection must be installed in the plant.

Risk of injury and property damage due to high pressure in the plant.

A suitable overpressure protection must be installed on site in the plant section.

2.1 Transportation and storage

The regulator must be carefully handled, transported and stored. Protect the excess pressure valve against adverse influences, such as dirt, moisture or frost, during storage and transportation.

When regulators are too heavy to be lifted by hand, fasten the lifting sling to a suitable place on the valve body.

Incorrectly attached lifting slings or supports.

Risk of injury and property damage due to valve falling.

Securely fasten slings or supports to the valve body and secure against slipping.

3 Design and principle of operation

See Fig. 1 and Fig. 2.

The Type 2422/2425 Excess Pressure Valve consists of the Type 2422 Valve and the Type 2425 Actuator. The Type 2422 Valve is available either balanced by a bellows or a diaphragm.

The excess pressure valve is used to maintain the pressure upstream of the valve to an adjusted set point. The valve opens when the upstream pressure rises.

The medium flows through the valve in the direction indicated by the arrow. The position of the plug (3) determines the flow rate across the area released between plug (3) and valve seat (2). The plug stem (4) with the plug is connected to the top diaphragm stem (8) of the actuator (10).

The upstream pressure p_1 is regulated by the set point springs (11) and the set point adjuster (13). When relieved of pressure, the valve is closed by the force of the set point springs.


The upstream pressure p_1 to be controlled is tapped upstream of the valve and transmitted over the control line to the operating diaphragm (9) where it is converted into a positioning force. This force is used to move the valve plug according to the force of the set point springs. When the force resulting from the upstream pressure p_1 rises above the adjusted set point, the valve opens proportionally to the change in pressure. The principle of operation of the Type 2422/2425 Excess Pressure Valve balanced by a bellows or diaphragm only differs concerning the pressure balancing. The valves balanced by a diaphragm have a balancing diaphragm (5.1) instead of a bellows (5). In both cases, the forces created by the upstream and downstream pressures that act on the valve plug are balanced out.

The valves can be supplied with flow divider ST 1 or ST 3. The valve seat must be replaced on retrofitting the flow divider.


The control of **vapors** and **liquids above 150** °C is only possible with a Type 2422 Valve balanced by a bellows. In this case, compensation chamber (20) is already installed in the control line ¹). The needle valve (18) in the control line is open and leadsealed.

Before start-up, fill the compensation chamber with the process medium at the filling opening (21) until it overflows.

 Only in combination with a control line kit. Otherwise, the compensation chamber must be ordered separately (> T 2595).

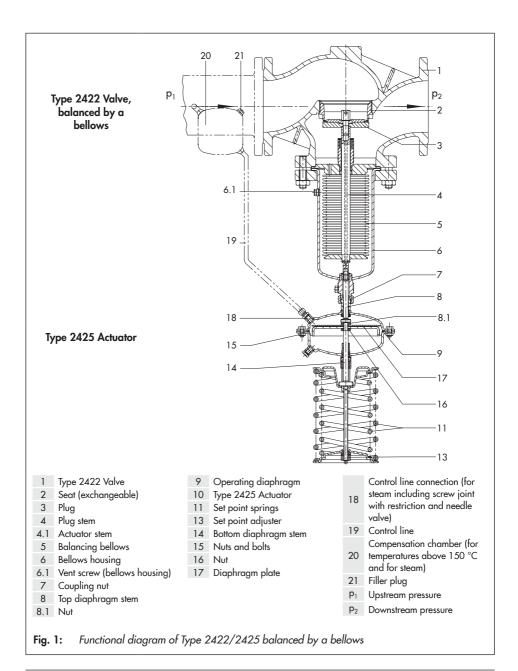

Installation

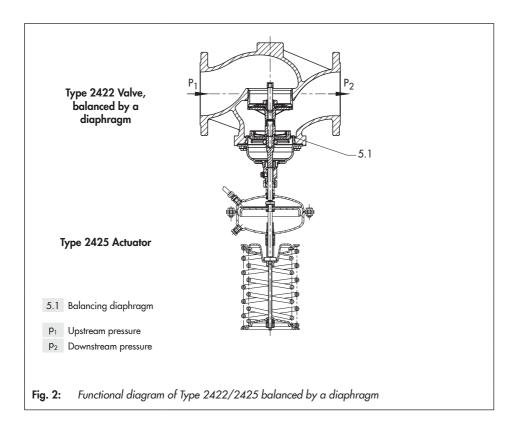

4 Installation

See Fig. 1 and Fig. 2.

4.1 Assembly

Valve and actuator can be assembled before or after the valve has been installed in the pipeline.

- → Relieve the set point springs of tension by turning the set point adjuster (13).
- → Place the actuator on the bellows housing and carefully screw it in as far as it will go. Make sure the control line connection points toward the upstream pressure side.
- → Hold the actuator and fasten it to the bellows housing using the coupling nut (7).

4.2 Mounting orientation

Select the installation location making sure that the regulator is installed at a distance of at least six times the nominal size (DN) away from pipe fittings or instruments that cause flow turbulence (e.g. pipe bends, manifolds, pressure measuring points or other valves). They can change the flow conditions which may lead to an instable control process especially in applications with gases, air or steam.


Contact SAMSON to obtain the TV-SK 17041 documentation which contains more details on installation requirements.

4.3 Notes on installation

Install the excess pressure valve in horizontal pipelines.

 Flush the pipeline thoroughly before installing the regulator to ensure that no impurities impair the proper functioning of the valve, above all the tight shut-off.

- The direction of flow must match the direction indicated by the arrow on the body.
- Install the regulator free of stress. If necessary, support the pipeline near the connecting flanges. Do not attach supports directly to the valve or actuator.
- Install a strainer upstream of the regulator.
- Protect the regulator from icing up when controlling media that can freeze. If necessary, depressurize and drain the regulator and remove it from the pipeline while the plant is shut down.

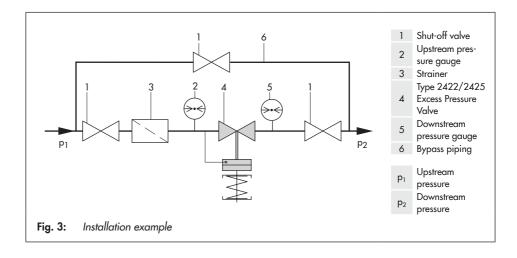

Mounting orientation

Valve balanced by a bellows/diaphragm

- Actuator facing downward



Pressure testing of the plant • The pressure must not exceed the maximum permissible pressure of the regulator and plant on testing the pressure of the plant when the regulator is already installed. An excessive test pressure can damage the operating diaphragm in the actuator.

Uncontrolled excess pressure in the plant may damage the operating diaphragm.

The maximum permissible pressure at the actuator must not exceed the pressure specified in Table 1.

| Table | 1: | Max. | perm. | pressure at actuator | |
|-------|----|------|-------|----------------------|--|
|-------|----|------|-------|----------------------|--|

| Actuator area | Max. perm. pressure |
|---------------------|---------------------|
| 640 cm ² | 1.5 bar |
| 320 cm ² | 3 bar |

To prevent damage to the diaphragm, take one of following precautions:

- Remove the regulator from the pipeline or isolate the regulator in the pipeline and install a bypass (see Fig. 3) or
- Detach the control line and seal the openings with end plugs or
- Install a shut-off valve in the control line.

4.4 Control line, compensation chamber and needle valve

Control line \cdot A control line must be provided at the site of installation, e.g. a $\frac{3}{8}$ " pipe for steam or an Ø8 x 1 or Ø6 x 1 mm copper pipe for air/water.

Connect the control line to the upstream line (p_1) at least one meter away from the valve inlet. If a manifold is located upstream of the excess pressure valve, connect the valve to the manifold, even if it is several meters away. If the upstream line is extended by a conical expansion piece, connect the control line in the expanded section of the line. Weld the control line at the side in the middle of the pipe, inclining at a ratio of approximately 1:10 up to the compensation chamber.

Weld the line coming from the pressure tapping point to the 3%" pipe socket on the chamber. Install the compensation chamber at the highest point of the pipeline. Consequently, the control line between compensation chamber and actuator must also be installed with a downward slope. In this case, use a 3%" pipe with screw fittings.

If the control line connection is located below the middle of the valve inlet flange, arrange the compensation chamber at the same level as the inlet flange. In this case, use a pipe which is at least ½" in size for the control line from the tapping point to the compensation chamber. If the control line is connected above the middle of the valve inlet flange, install the compensation chamber at the same level as the upstream pressure tapping point. The additional pressure of the condensate head must be compensated for by adjusting the set point to a higher value.

Control line kit · A control line kit for tapping pressure directly at the valve body is available as an accessories part from SAM-SON (for set points ≥0.8 bar). See ► T 2595.

Compensation chamber · A compensation chamber is required for liquids **above 150** °C as well as for **steam.** The mounting position of the compensation chamber is indicated by an adhesive label on the chamber itself as well as by an arrow and the word "top" stamped on the top of the chamber.

This mounting position must be adhered to; otherwise the safe functioning of the excess pressure valve cannot be guaranteed.

Needle valve · If the regulator tends to hunt, install a needle valve at the control line connection (18) in addition to the standard SAMSON screw joint with restriction.

4.5 Strainers

Install the strainer upstream of the excess pressure valve (see Fig. 3).

- Do not use the strainer to permanently filter the process medium.
- The direction of flow must correspond to the arrow on the body.
- The filter element must be installed to hang downwards or sideways for applications with steam.

🔆 Tip

Remember to leave enough space to remove the filter element.

4.6 Shut-off valve

Install a hand-operated shut-off valve both upstream of the strainer and downstream of the regulator. This allows the plant to be shut down for cleaning and maintenance and when the plant is not used for longer periods of time (see Fig. 3).

4.7 Pressure gauge

Install a pressure gauge both upstream and downstream of the regulator to monitor the pressures prevailing in the plant (see Fig. 3).

Install the pressure gauge on the upstream side in front of the pressure tapping point.

5 Operation

See Fig. 1 and Fig. 2.

5.1 Start-up

Do not start up the regulator until all parts have been mounted. Make sure the control line is open and correctly connected.

Fill the plant **slowly** with the process medium. Avoid pressure surges. Open the shutoff valves first on the upstream pressure side. Afterwards, open all the valves on the consumer side (downstream of the regulator).

Regulation of steam

Observe the following points for applications with steam:

- Before start-up, all pipes conveying the process medium must be completely drained and dry (to prevent steam hammering).
- Before start-up, fill the compensation chamber (20) with water at the filling opening (21) until it overflows. Screw the plug back in.
- Slowly start up the plant and allow time for the pipes and valves to heat up.

Air and condensate must be allowed to escape from the plant. Install steam trap or air vent for steam-operated systems at a suitable location.

Control applications with liquids

To start up the excess pressure valve, open shut-off valves slowly. To vent the bellows space, unscrew the vent screw (6.1). After the air has escaped from the bellows space, retighten the vent screw (6.1).

For temperatures above 150 $^{\circ}\mathrm{C},$ first fill the compensation chamber with the process medium.

5.2 Adjusting the set point

Adjust the required upstream pressure by turning the set point adjuster (13).

Turn clockwise 🛡

The upstream pressure is increased (higher pressure set point)

Turn counterclockwise 🗸

The upstream pressure is reduced (lower pressure set point)

When the force resulting from the upstream pressure p₁ rises above the adjusted set point, the valve opens proportionally to the change in pressure.

∹∑⁻ Тір

Monitor the adjusted set point pressure at the pressure gauge on the upstream pressure side.

Changing the set point range

The set point range is determined by the size of the actuator and its set point springs. The set point range can only be changed by exchanging the entire actuator assembly. Therefore, we recommend contacting us if you want to change the set point range.

5.3 Decommissioning

Close first the shut-off valve on the upstream side of the valve and then on the down-stream side of the valve.

6 Maintenance and troubleshooting

If the upstream pressure deviates considerably from the set point, check the control line for blockage and check the diaphragm for leakage.

In case of other causes, such as a damaged seat or plug, we recommend contacting SAMSON's After-sales Service (see Chapter 8).

If the diaphragm is damaged, proceed as described in Chapter 2.1.

Risk of scalding due to hot process medium escaping uncontrolled.

Allow the regulator to cool down before depressurizing and draining it and remove it from the pipeline.

6.1 Replacing the operating diaphragm

See Fig. 1 and Fig. 2.

Shut down the plant by slowly closing the shut-off valves. Depressurize the relevant section of the pipeline and, if necessary, drain it as well. The actuator can be removed from the valve without having to remove the valve from the pipeline. However, in this case, do not forget that the actuator cone seals off the bellows housing. Consequently, the process medium will drain out of the valve on removing the actuator.

- Relieve the spring assembly of tension by turning the set point adjuster (13) counterclockwise.
- 2. Unscrew the control line and clean it.
- 3. Undo the coupling nut (7) and remove the actuator.
- Unscrew the set point adjuster (13). Remove bearing, bushing, spring(s) and spring plate.
- 5. Remove nuts and bolts (15). Lift the top cover plate off the actuator stem.
- 6. Pull the diaphragm stems together with the diaphragm plates and the diaphragm out of the lower diaphragm case.
- Hold the bottom nut (16) stationary using a socket wrench and unscrew the top diaphragm stem by loosening the nut (8.1) (the nut is sealed with paint!).
- Take off the top diaphragm plate (17). Replace the operating diaphragm (9) with a new one.


Proceed in the reverse order to reassemble the regulator. For start-up, proceed as described in Chapter 5.1.

7 Nameplate


Several nameplates are affixed to the device. The nameplates shown were up to date at the time of publication of this document. The nameplates on the device may differ from

7.1 Nameplates

the ones shown. The nameplates are used to identify the separate regulator components (see Fig. 4).

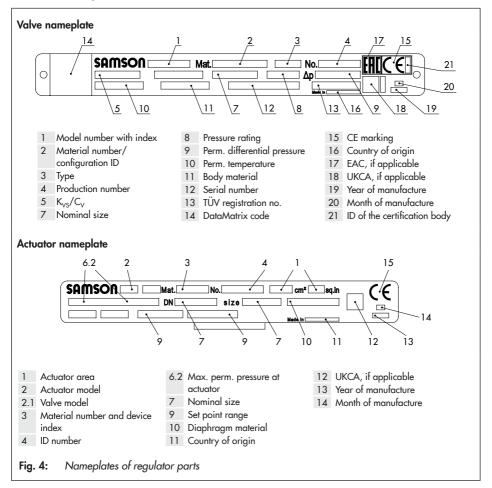

7.2 Location of the nameplates



7.3 Material identification number

7.3.1 Type 2422 Valve

See the nameplate (11 for DIN/ANSI version, body material) for the material used. For more details on the nameplate, see Chapter 7.1.

7.3.2 Type 2425 Actuator

Specifying the material number, you can contact SAMSON to find out which material is used. It is specified on the nameplate in the 'MNo.' field (3 for DIN/ANSI). For more details on the nameplate, see Chapter 7.1.

8 After-sales service

If malfunctions or defects occur, contact the SAMSON's After-sales Service for support.

The addresses of SAMSON AG, its subsidiaries, representatives and service facilities worldwide can be found on our website (www.samsongroup.net), in all SAMSON product catalogs or on the back of these Mounting and Operating Instructions.

Please send your inquiries to: service@samsongroup.com

To assist diagnosis, specify the following details (see Chapter 7):

- Valve type and nominal size
- Model number and configuration ID
- Order number or date
- Upstream and downstream pressure
- Temperature and process medium
- Min. and max. flow rate in m³/h
- Is a strainer installed?
- Installation drawing showing the exact location of the regulator and all the additionally installed components (shutoff valves, pressure gauge etc.)

9 Disposal



SAMSON is a producer registered at the following European institution ► https://www.samsongroup. com/en/about-samson/ environment-social-governance/ material-compliance/wasteelectrical-and-electronicequipment-weee-and-its-safedisposal/. WEEE reg. no. DE 62194439

Information on substances listed as substances es of very high concern (SVHC) on the candidate list of the REACH regulation can be found in the document "Additional Information on Your Inquiry/Order", which is added to the order documents, if applicable. This document includes the assigned SCIP number, which can be entered into the database on the European Chemicals Agency (ECHA) website (>https://www.echa.europa.eu/ scip-database) to find out more information on the SVHC.

i Note

SAMSON can provide you with a recycling passport on request. Simply e-mail us at aftersalesservice@samsongroup.com giving details of your company address.

∹∑- Tip


On request, SAMSON can appoint a service provider to dismantle and recycle the product as part of a distributor take-back scheme.

- ➔ Observe local, national and international refuse regulations.
- ➔ Do not dispose of components, lubricants and hazardous substances together with your other household waste.

10 Dimensions

| Type 2422/2425 · Balanced by a bellows | | | | | | | |
|--|--------------------|-----------------|---------------------------------|----------------------------------|-------------------------------|--------|--|
| | minal size | nd weights in F | diversion of the values in pair | rentheses apply to ter DN 150 | mperatures from 220 DN 200 | DN 250 | |
| Len | gth L | | 400 | 480 | 600 | 730 | |
| Hei | ght H1 | | 460 (600) | 570 (730) | 730 (| 870) | |
| Hei | ght H2 | | 145 | 175 | 235 | 260 | |
| | - | Height H | 990 (1130) | 1120 (1260) | 1260 (| 1400) | |
| | 0.05 to 0.25 | Actuator | | ØD = 380, A | $A = 640 \text{ cm}^2$ | | |
| bar | 0.1.1.0.4 | Height H | 990 (1130) | 1120 (1260) | 1260 (| 1400) | |
| Set point ranges in bar | 0.1 to 0.6 | Actuator | | ØD = 380, A | $A = 640 \text{ cm}^2$ | | |
| Jge | | Height H | 990 (1130) | 1120 (1260) | 1260 (| 1400) | |
| Ī | 0.2 to 1.0 | Actuator | | ØD = 380, A | $A = 640 \text{ cm}^2$ | | |
| oin | | Height H | 940 (1050) | 1040 (1180) | 1210 (| 1350) | |
| etb | 0.5 to 1.5 | Actuator | | ØD = 285, A | | | |
| S | | Height H | 940 (1080) | 1070 (1210) | 1210 (| 1350) | |
| | 1 to 2.5 | Actuator | | ØD = 285, A | $A = 320 \text{ cm}^2$ | | |
| We | ight 1) based on a | 1 | 6, approx. kg | | | | |
| | 0.05 to 1.0 | | 135 | 116 | 286 | 296 | |
| 0.5 to 1.5/1 to 2.5 | | | 125 | 110 | 280 | 290 | |
| 1) - | +10 % for cast ste | eel, spheroida | l graphite iron and fo | orged steel | | | |

Fig. 6: Dimensions · Type 2422/2425 · Balanced by a bellows

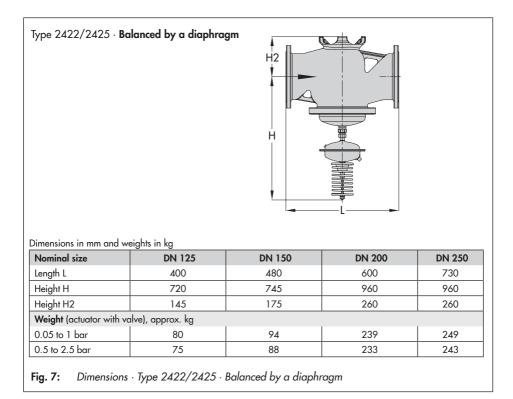

11 Technical data

Table 2: Technical data of Type 2422 Valve and Type 2425 Actuator

| Type 2422 Valve | | | | | | |
|---|-----------------------------|---|-----------------|----------|-----------------|--|
| Nominal size | | DN 125 | DN 150 | DN 200 | DN 250 | |
| Pressure rating | | | PN 16,2 | 25 or 40 | | |
| Max. permissible temperature | Balanced by a bellows | Metal seal: max. 350 °C · PTFE soft seal: max. 220 °C · EPDM or FKM soft seal: max. 150 °C · NBR soft seal: max. 80 °C ¹⁾ | | | | |
| | Balanced by a diaphragm | 150 °C | | | | |
| Leakage class acco IEC 60534-4 | ording to | ≤0.05 % of K_{VS} coefficient | | | | |
| Conformity | | CE | | | | |
| Type 2425 Actuator | | | | | | |
| Set point ranges | | 0.05 to 0.25 bar · 0.1 to 0.6 bar · 0.2 to 1 bar 0.5 to 1.5 bar ·1 to 2.5 bar ²⁾ | | | to 1 bar | |
| Max. permissible pressure at actuator | Effective diaphragm area | 320 | cm ² | 640 | cm ² | |
| | Pressure | 3 k | bar | 1.5 bar | | |
| Max. permissible temperature | | Gases 80 °C at the actuator ¹⁾ · Liquids 150 °C, with compensation chamber max. 350 °C · Steam with compensation chamber max. 350 °C | | | eam with | |

¹⁾ For oxygen max. 60 °C
 ²⁾ Set point ranges above 2.5 bar ► T 2552 (Type 2335 Excess Pressure Valve)

12 Certificates

The EU declarations of conformity are included on the next pages:

- EU declaration of conformity in compliance with Pressure Equipment Directive 2014/68/EU on Page 21.
- EU declaration of conformity in compliance with Machinery Directive 2006/42/EC for Type 2422/2425 Regulator on Page 24.
- Declaration of incorporation in compliance with Machinery Directive 2006/42/EC for the Type 2422 Valve with other actuators other than the Type 2425 Actuator on Page 25.

EU DECLARATION OF CONFORMITY



Module H / N° CE-0062-PED-H-SAM 001-22-DEU

For the following products, SAMSON hereby declares under its sole responsibility:

| Devices | Series | Type | Version |
|--------------------------|--------|--------|--|
| | | | DIN EN, body, EN-GJL-250 and 1.0619, DN 150, PN 16, fluids G2, L2, L11) |
| | | | DIN EN, body, 1.0619, DN 100-150, PN 25, fluids G2, L2, L11) |
| Three-way valve | | 2119 | DIN EN, body, 1.0619 and 1.4408, DN 65-150, PN 40, fluids G2, L2, L11) |
| | | | ANSI, body, A216 WCC and A351 CF8M, NPS 6, Class 150, fluids G2, L2, L11) |
| | | | ANSI, body, A216 WCC and A351 CF8M, NPS 2-6, Class 300, fluids G2, L2, L11) |
| Self-operated Regulators | | 3222 | DIN EN, body, CC499K, DN 50, PN 25, all fluids |
| Three-way valve | | 3260 | DIN EN, body, EN-GJL-250, DN 250-300, PN 16, fluids G2, L21) |
| Globe valve | | 3531 | DIN EN, body, 1.0619 and 1.4408, DN 50-80, PN 25, all fluids |
| Three-way valve | V2001 | 3535 | ANSI, body, A216 WCC and A351 CF8M, NPS 21/2-3, Class 150, all fluids |
| | | | DIN EN, body, EN-GJL-250, DN 150-400, PN 16, fluids G2, L2, L11) |
| | | | DIN EN, body, EN-GJS-400-18-LT, DN 100-150, PN 25, fluids G2, L2, L11) |
| | | | DIN EN, body, 1.0619, DN 32-400, PN 40, all fluids |
| Control valve | | 3214 | ANSI, body, A126 B, NPS 6-10, Class 125, fluids G2, L2, L11) |
| | | | ANSI, body, A216 WCC, NPS 21/2-10, Class 150, all fluids |
| | | | ANSI, body, A216 WCC, NPS 11/2-10, Class 300, all fluids |
| | | | DIN EN, body, EN-GJL-250, DN 150-250, PN 16, fluids G2, L2, L1 ¹⁾ |
| | | | DIN EN, body, EN-GJS-400-18-LT, DN 150, PN 16, fluids G2, L2, L1 ¹⁾ |
| | | | DIN EN, body, EN-GJS-400-18-LT, DN 100-150, PN 25, fluids G2, L2, L1 ¹⁾ |
| | | | DIN EN, body, 1.0619 and 1.4408, DN 65-250, PN 16, all fluids |
| | 42 | 2423 | DIN EN, body, 1.0619 and 1.4408, DN 50-250, PN 10, all fluids |
| | 42 | 2423 | DIN EN, body, 1:0619 and 1:4408, DN 30-250, PN 40, all fluids |
| | | | ANSI, body, A126 B, NPS 6-10, Class 125, fluids G2, L2, L1 ¹⁾ |
| | | | |
| | | | ANSI, body, A216 WCC and A351 CF8M, NPS 21/-10, Class 150, all fluids |
| | | | ANSI, body, A216 WCC and A351 CF8M, NPS 1½-10, Class 300, all fluids |
| | | | DIN EN, body, EN-GJL-250, DN 150-400, PN 16, fluids G2, L2, L1 ¹) |
| | | | DIN EN, body, EN-GJS-400-18-LT, DN 100-150, PN 25, fluids G2, L2, L1 ¹⁾ |
| | | | DIN EN, body, 1.0619 and 1.4408, DN 65-400, PN 16, all fluids |
| | | | DIN EN, body, 1.0619 and 1.4408, DN 200-400, PN 25, all fluids |
| | | | DIN EN, body, 1.0619 and 1.4408, DN 32-400, PN 40, all fluids |
| | | | DIN EN, body, 1.0460, DN 40-50, PN 40, all Fluids |
| Self-operated Regulators | | | DIN EN, body, 1.6220+QT, DN 65-250, PN 16, all fluids |
| | 42 | 2422 | DIN EN, body, 1.6220+QT, DN 200-250, PN 25, all fluids |
| | | | DIN EN, body, 1.6220+QT, DN 32-250, PN 40, all fluids |
| | | | ANSI, body, A126 B, NPS 6-16, Class 125, fluids G2, L2, L11) |
| | | | ANSI, body, A216 WCC and A351CF8M, NPS 21/2-16, Class 150, all fluids |
| | | | ANSI, body, A216 WCC and A351CF8M, NPS 11/2-16, Class 300, all fluids |
| | | | ANSI, body, A105, NPS 11/2-2, Class 300, all fluids |
| | | | ANSI, body, A352 LCC, NPS 21/2-10, Class 150, all fluids |
| | | | ANSI, body, A352 LCC, NPS 11/2-10, Class 300, all fluids |
| | | | DIN EN, body, 1.0619 and 1.4408, DN 65-150, PN 16, all fluids |
| | | | DIN EN, body, 1.0619 and 1.4408, DN 50-150, PN 25, all fluids |
| | | 1 | DIN EN, body, 1.0619 and 1.4408, DN 32-150, PN 40, all fluids |
| | 42 | 2421RS | DIN EN, body, 1.4571 and 1.4401/1.4404, DN 50, PN 25, all fluids |
| | | | DIN EN, body, 1.4571 and 1.4401/1.4404, DN 32-50, PN 40, all fluids |
| | | | ANSI, body, A216 WCC and A351 CF8M, NPS 21/2-6, Class 150, all fluids |
| | 1 | | ANSI, body, A216 WCC and A351 CF8M, NPS 11/2-6, Class 300, all fluids |
| | 1 | 1 | ·····, -··, ····, ···· |

Revision 00

Classification: Public · SAMSON AKTIENGESELLSCHAFT · Weismuellerstrasse 3 · 60314 Frankfurt am Main, Germany Page 1 of 3

EU DECLARATION OF CONFORMITY



| Devices | Series | Туре | Version |
|--------------------------|--------|--------------|--|
| 2011000 | 0000 | | DIN EN, body, 1.0619, 1.4571, 1.4404, 1.4408, 1.0460, DN 32-50, PN40, all fluids |
| | | 2405 | ANSI, body, A105, A182 F316L, A351 CF8M, A216 WCC, NPS 1½-2, Class 300, all fluids |
| | | | DIN EN, body, EN-GJL-250, DN 150, PN 16, fluids G2, L2, L1 ¹⁾ |
| | | | DIN EN, body, 1.0619 and 1.4408, DN 32-150, PN 40, all fluids |
| | 40 | | DIN EN, body, 1.0460 and 1.4404, DN 32-50, PN 40, all fluids |
| | | 2406 | ANSI, body, A126 B, NPS 6, Class 125, fluids G2, L2, L1 ¹⁾ |
| | | | ANSI, body, A216 WCC and A351 CF8M, NPS 2½-6, Class 150, all fluids |
| | | | ANSI, body, A216 WCC and A351 CF8M, NPS 11/2-6, Class 300, all fluids |
| | | | ANSI, body, A105 and A182 F316L, NPS 11/2-2, Class 300, all fluids |
| | | | DIN EN, body, EN-GJS-400-18-LT, DN 100, PN25, fluids G2, L2, L1 ¹⁾ |
| | | | DIN EN, body, 1.0619 and 1.4408, DN 32-100, PN 40, all fluids |
| | | 2412 | DIN EN, body, 1.0460, 1.4571 and 1.4404, DN 32-80, PN 40, all fluids |
| | 41 | 2412 | ANSI, body, A216 WCC and A351 CF8M, NPS 21/2-4, Class 150, all fluids |
| | | | ANSI, body, A216 WCC and A351 CF8M, NPS 1½-4, Class 300, all fluids |
| | | | ANSI, body, A105 and A182 F316L, NPS 1½-3, Class 300, all fluids |
| | | | DIN EN, body, EN-GJL-250, DN 150, PN16, fluids G2, L2, L1 ¹⁾ |
| | | | DIN EN, body, 1.0619 und 1.4408, DN 32-150, PN 40, all fluids |
| | | 2404-1 | ANSI, body, A126 B, NPS 6, Class 125, fluids G2, L2, L1 ¹⁾ |
| | | 2404-1 | ANSI, body, A126 B, NI 56, Class 120, India 62, E2, E1 - |
| | | | ANSI, body, A216 WCC und A351 CF8M, NPS 2/2-6, Class 150, all fluids ANSI, body, A216 WCC und A351 CF8M, NPS 1/2-6, Class 300, all fluids |
| | | | DIN EN, body, EN-GJL-250, DN 150-400, PN 16, fluids G2, L2, L1 ¹⁾ |
| | | | DIN EN, body, 1.0619 und 1.4408, DN 65-400, PN 16, all fluids |
| | | | DIN EN, body, 1.0619 und 1.4408, DN 65-400, PN 40, all fluids |
| | | 2404-2 | |
| Self-operated Regulators | | | ANSI, body, A126 B, NPS 6-16, Class 125, fluids G2, L2, L1 ¹⁾ ANSI, body, A216 WCC und A351 CF8M, NPS 2½-16, Class 150, all fluids |
| Sell-operated Regulators | | | ANSI, body, A216 WCC und A351 CF6M, NPS 2/2-10, Class 150, all fluids ANSI, body, A216 WCC und A351 CF8M, NPS 2/2-10, Class 300, all fluids |
| | | | DIN EN, body, EN-GJL-250, DN 250, PN 16, fluids G2, L2 ¹⁾ |
| | | | DIN EN, body, EN-GJC-250, DN 250, PN 16, fluids G2, L2 ¹ |
| | | 2331 2337 | DIN EN, body, 1.0619, DN 200-250, PN 25, fluids G2, L2 ¹⁾ |
| | | 2337 | DIN EN, body, 1.0619, DN 125-250, PN 20, fluids G2, L2 ¹ |
| | | | DIN EN, body, FI-GJL-250, DN 150-400, PN 16, fluids G2, L2, L1 ¹⁾ |
| | | | DIN EN, body, EN-GJS-230, DN 130-400, PN 16, India G2, L2, L1 ¹ |
| | | | DIN EN, body, 1.0619 and 1.4408, DN 65-400, PN 16, all fluids |
| | | | DIN EN, body, 1.0619 and 1.4408, DN 200-400, PN 25, all fluids |
| | | 2333 2335 | DIN EN, body, 1.0619 and 1.4408, DN 65-400, PN 40, all fluids |
| | | 2000 | ANSI, body, A126 B, NPS 6-16, Class 125, fluids G2, L2, L1 ¹⁾ |
| | | | ANSI, body, A126 B, NF3 6-16, Class 125, Illius 62, L2, E1 / ANSI, body, A216 WCC and A351 CF8M, NPS 2½-16, Class 150, all fluids |
| | | | ANSI, body, A216 WCC and A351 CF8M, NPS 2½-16, Class 150, all fluids ANSI, body, A216 WCC and A351 CF8M, NPS 2½-16, Class 300, all fluids |
| | | | DIN EN, body, EN-GJL-250, DN 150-400, PN 16, fluids G2, L2, L1 ¹⁾ |
| | | | DIN EN, body, EN-GJS-200, DN 150-400, PN 16, fluids G2, L2, L1 ¹ |
| | | | DIN EN, body, EN-GJS-400-18-ET, DN 130, TN 10, Holds G2, E2, E1 7 |
| | | | DIN EN, body, 1.0619 and 1.4408, DN 65-400, PN 16, all fluids |
| | | 2334 | |
| | | 2334 | DIN EN, body, 1.0619 and 1.4408, DN 200-400, PN 25, all fluids DIN EN, body, 1.0619 and 1.4408, DN 65-400, PN 40, all fluids |
| | | | |
| | | | ANSI, body, A126 B, NPS 6-16, Class 125, fluids G2, L2, L1 ¹⁾ ANSI, body, A216 WCC and A351 CF8M, NPS 2½-16, Class 150, all fluids |
| | | | |
| | | | ANSI, body, A216 WCC and A351 CF8M, NPS 2½-16, Class 300, all fluids |
| | | 2373 2375 | DIN EN, body, 1.4469 and 1.4470, DN 32-50, PN 40, all fluids |
| | | 2010 | ANSI, body, A995 5A and A995 4A, NPS 11/2-2, Class 300, all fluids |
| | | | DIN EN, body, EN-GJL-250, DN 150-250, PN 16, fluids G2, L2, L1 ¹⁾ |
| Strainers | 2N/2NI | 2602 | DIN EN, body, EN-GJS-400-18-LT, DN 150, PN 16, fluids G2, L2, L11) |
| Granoro | | | DIN EN, body, EN-GJS-400-18-LT, DN 100-150, PN 25, fluids G2, L2, L1 ¹⁾ |
| | | | DIN EN, body, 1.0619, DN 100-250, PN 16, all fluids |

Revision 00

Classification: Public · SAMSON AKTIENGESELLSCHAFT · Weismuellerstrasse 3 · 60314 Frankfurt am Main, Germany Page 2 of 3

EU DECLARATION OF CONFORMITY TRANSLATION



| Devices | Series | Туре | Version |
|-----------|-----------------------|------|---|
| | Strainers 2N/2NI 2602 | | DIN EN, body, 1.0619, DN 200-250, PN 25, all fluids |
| Strainers | | 2602 | DIN EN, body, 1.0619, DN 32-250, PN 40, all fluids |
| | | | DIN EN, body, 1.4408, DN 65-100, PN 16, all fluids |
| | | | DIN EN, body, 1.4408, DN 32-100, PN 40, all fluids |

¹⁾Gases according to Article 4(1)(c.i), second indent Liquids according to Article 4(1)(c.ii)

That the products mentioned above comply with the requirements of the following standards:

| Directive of the European Parliament and of the Council on the harmonization of the laws of the Member States relating to the making available on the market of pressure equipment | 2014/68/EU | of 15. May 2014 | |
|---|------------|------------------------|--|
| Applied conformity assessment procedure for fluids according to Article 4(1) | Module H | by Bureau Veritas 0062 | |

The manufafacturer's quality management system is monitored by the following notified body: Bureau Veritas Services SAS, 8 Cours du Triangle, 92800 PUTEAUX – LA DEFENSE, FRANCE Technical standards applied: DIN EN 12516-2, DIN EN 12516-3, ASME 8 16.34

Manufacturer: SAMSON AG, Weismuellerstrasse 3, 60314 Frankfurt am Main, Germany

Frankfurt am Main, 14. October 2022

ppc. U. Trely ppa. Norbert Tollas

Senior Vice President Global Operations

i. v. P. Unum

i.V. Peter Scheermesser Director Product Maintenance & Engineered Products

Revision 00

D---- 0 -60

EU DECLARATION OF CONFORMITY



Declaration of Conformity of Final Machinery

in accordance with Annex II, section 1.A. of the Directive 2006/42/EC

For the following product:

Type 2422/2425 Excess Pressure Valve consisting of Type 2422 Valve and Type 2425 Actuator

We hereby declare that the machinery mentioned above complies with all applicable requirements stipulated in Machinery Directive 2006/42/EC.

For product descriptions refer to:

- Type 2422/2425 Excess Pressure Valve: Mounting and Operating Instructions EB 2549

Referenced technical standards and/or specifications:

- VCI, VDMA, VGB: "Leitfaden Maschinenrichtlinie (2006/42/EG) Bedeutung f
 ür Armaturen, Mai 2018" [German only]
- VCI, VDMA, VGB: "Zusatzdokument zum Leitfaden Maschinenrichtlinie (2006/42/EG) Bedeutung f
 ür Armaturen vom Mai 2018" [German only], based on DIN EN ISO 12100:2011-03

Comment:

Information on residual risks of the machinery can be found in the mounting and operating instructions of the valve and actuator as well as in the referenced documents listed in the mounting and operating instructions.

Persons authorized to compile the technical file: SAMSON AG, Weismüllerstraße 3, 60314 Frankfurt am Main, Germany Frankfurt am Main, 4 March 2022

U. Del Opc.

Norbert Tollas Director Global Operations

i. V. P. Ulumin

Peter Scheermesser Director Product Life Cycle Management and ETO Development for Valves and Actuators

Revision no. 00

Classification: Public · SAMSON AKTIENGESELLSCHAFT · Weismüllerstraße 3 · 60314 Frankfurt, Germany

Page 1 of 1

DECLARATION OF INCORPORATION



Declaration of Incorporation in Compliance with Machinery Directive 2006/42/EC

For the following product: Type 2420 Actuator

We certify that the Type 2420 Actuator is partly completed machine as defined in the Machinery Directive 2006/42/EC and that the safety requirements stipulated in Annex 1, 1.1.2, 1.1.3, 1.1.5, 1.3.2, 1.3.4 and 1.3.7 are observed. The relevant technical documentation described in Annex VII, part B has been compiled.

Products we supply must not be put into service until the final machinery into which it is to be incorporated has been declared in conformity with the provisions of the Machinery Directive 2006/42/EC.

Operators are obliged to install the products observing the accepted industry codes and practices (good engineering practice) as well as the mounting and operating instructions. Operators must take appropriate precautions to prevent hazards that could be caused by the process medium and operating pressure in the valve as well as by the signal pressure and moving parts.

The permissible limits of application and mounting instructions for the products are specified in the associated data sheets as well as the mounting and operating instructions; the documents are available in electronic form on the Internet at www.samsongroup.com.

For product descriptions refer to:

- Type 42-20 Differential Pressure Regulator: Mounting and Operating Instructions EB 3007

Referenced technical standards and/or specifications:

- VCI, VDMA, VGB: "Leitfaden Maschinenrichtlinie (2006/42/EG) Bedeutung für Armaturen, Mai 2018" [German only]
- VCI, VDMA, VGB: "Zusatzdokument zum Leitfaden Maschinenrichtlinie (2006/42/EG) Bedeutung für Armaturen vom Mai 2018" [German only], based on DIN EN ISO 12100:2011-03

Comments:

- See mounting and operating instructions for residual hazards.
- Also observe the referenced documents listed in the mounting and operating instructions.

Persons authorized to compile the technical file:

SAMSON AG, Weismüllerstraße 3, 60314 Frankfurt am Main, Germany Frankfurt am Main, 11 February 2022

Stephan Giesen Director Product Management

i. V. P. Ulumin

Peter Scheermesser Director Product Life Cycle Management and ETO Development for Valves and Actuators

Revision no. 00 Page 1 of 1

Classification: Public · SAMSON AKTIENGESELLSCHAFT · Weismüllerstraße 3 · 60314 Frankfurt, Germany

DECLARATION OF INCORPORATION



Declaration of Incorporation in Compliance with Machinery Directive 2006/42/EC

For the following product: Type 2425 Actuators

We certify that the Type 2425 Actuator is partly completed machine as defined in the Machinery Directive 2006/42/EC and that the safety requirements stipulated in Annex I, 1.1.2, 1.1.3, 1.1.5, 1.3.2, 1.3.4 and 1.3.7 are observed. The relevant technical documentation described in Annex VII, part B has been compiled.

Products we supply must not be put into service until the final machinery into which it is to be incorporated has been declared in conformity with the provisions of the Machinery Directive 2006/42/EC.

Operators are obliged to install the products observing the accepted industry codes and practices (good engineering practice) as well as the mounting and operating instructions. Operators must take appropriate precautions to prevent hazards that could be caused by the process medium and operating pressure in the valve as well as by the signal pressure and moving parts.

The permissible limits of application and mounting instructions for the products are specified in the associated data sheets as well as the mounting and operating instructions; the documents are available in electronic form on the Internet at www.samsongroup.com.

For product descriptions refer to:

- Type 42-25 Differential Pressure Regulator: Mounting and Operating Instructions EB 3007
- Type 2422/2425 Excess Pressure Valve: Mounting and Operating Instructions EB 2549

Referenced technical standards and/or specifications:

- VCI, VDMA, VGB: "Leitfaden Maschinenrichtlinie (2006/42/EG) Bedeutung f
 ür Armaturen, Mai 2018" [German only]
- VCI, VDMA, VGB: "Zusatzdokument zum Leitfaden Maschinenrichtlinie (2006/42/EG) Bedeutung f
 ür Armaturen vom Mai 2018" [German only], based on DIN EN ISO 12100:2011-03

Comments:

- See mounting and operating instructions for residual hazards.
- Also observe the referenced documents listed in the mounting and operating instructions.

Persons authorized to compile the technical file:

SAMSON AG, Weismüllerstraße 3, 60314 Frankfurt am Main, Germany Frankfurt am Main, 11 February 2022

Stephan Giesen Director Product Management

i. V. P. Ulumin

Peter Scheermesser Director Product Life Cycle Management and ETO Development for Valves and Actuators

Revision no. 00

Classification: Public · SAMSON AKTIENGESELLSCHAFT · Weismüllerstraße 3 · 60314 Frankfurt, Germany

Page 1 of 1

Certificates

EB 2549 EN



SAMSON AKTIENGESELLSCHAFT Weismüllerstraße 3 · 60314 Frankfurt am Main, Germany Phone: +49 69 4009-0 · Fax: +49 69 4009-1507 samson@samsongroup.com · www.samsongroup.com