

## T 8387-3S EN

**TROVIS SAFE 3731-3 Electropneumatic Ex d Positioner**  
 with HART® communication

**TROVIS SAFE**
**For on/off valves in safety-instrumented systems**
**Application**

Single-acting or double-acting Ex d positioner for attachment to pneumatic on/off valves in safety-instrumented systems. Self-calibrating, automatic adaptation to valve and actuator.

<b>Set point</b>	<b>4 to 20 mA</b>
<b>Valve travel</b>	<b>3.6 to 200 mm</b>
<b>Opening angle</b>	<b>24 to 100°</b>

The discrete analysis of the set point is performed in automatic mode. The positioner moves the valve to the operating point or fail-safe position depending on the adjustable limits. An automated partial stroke test is started when the set point is between the predefined upper and lower test limits.

**Special features**

- Certified according to IEC 61508/SIL
- Preset parameters for on/off valves in safety-instrumented systems
- Integrated EXPERTplus diagnostics with partial stroke testing for valves in safety-instrumented systems ▶ T 8389S
- Optional fault alarm output for alarms generated by the EXPERTplus valve diagnostics
- Simple attachment to all common linear and rotary actuators with interface for SAMSON direct attachment, NAMUR rib or valves with rod-type yokes according to IEC 60534-6-1, or to rotary actuators according to VDI/VDE 3845
- Any desired mounting position of the positioner (but not suspended)
- Simple one-knob, menu-driven operation also in hazardous areas
- LCD easy to read in any mounted position due to selectable reading direction
- Configurable with a PC over the SSP interface using the TROVIS-VIEW software
- Variable, automatic start-up with four different initialization modes
- Preset parameters · Only values deviating from the standard need to be adjusted
- Calibrated travel sensor without gears susceptible to wear
- Sub initialization mode (substitution) allows the positioner to be started up in case of emergency whilst the plant is running without the valve moving through the whole travel range



**Fig. 1:** TROVIS SAFE 3731-3 Electropneumatic Ex d Positioner with HART® communication

- Permanent storage of all parameters in EEPROM (protected against power failure)
- Two-wire system with a small electrical load of 450 Ω at 20 mA
- Adjustable output pressure limitation
- Activatable tight-closing function
- Continuous monitoring of zero point
- Integrated temperature sensor and operating hours counter
- Self-diagnostics; messages according to NAMUR Recommendation NE 107, optionally issued by an analog position transmitter
- Integrated EXPERTplus diagnostics for on/off valves (▶ T 8389S)

**Versions**

SIL-certified positioner for on/off valves, with display, on-site operation, local communication with SSP interface, diagnostic functions

### Additional options

- Binary contact, output acc. to NAMUR (EN 60947-5-6) or directly to PLC, configurable as a limit contact or fault alarm output
- Binary input
- Analog position transmitter with two-wire transmitter
- Forced venting (solenoid valve function)

### Principle of operation

The positioner is mounted on pneumatic on/off valves and is used to assign the valve position (controlled variable  $x$ ) to the control signal (set point  $w$ ). The positioner compares the electric control signal of a control system to the travel or rotational angle of the valve and issues a signal pressure (output variable  $y$ ) for the pneumatic actuator.

The positioner mainly consists of an electric travel sensor system (2), an analog i/p module with a downstream air capacity booster and the electronics with the microcontroller (5).

When a set point deviation occurs, the actuator is either vented or filled with air. Using the software, the signal pressure to the actuator can be limited to 1.4, 2.4 or 3.7 bar.

A constant air stream with a fixed set point to the atmosphere is created by flow regulator (9) with a fixed set point. The i/p module (6) is supplied with a constant upstream pressure by the pressure reducer (8) to make it independent of the supply air pressure.

### Operation also in hazardous areas

The rotary pushbutton and display are accessible without having to open the positioner housing. As result, the positioner is still fully operable under hazardous area conditions.

The positioner is operated with a user-friendly rotary pushbutton. The parameters are selected by turning the button, pushing it activates the required setting. In the menu, all parameters are listed in one level, eliminating the need to search in submenus. All parameters can be checked and changed on site.

All values are displayed on the LCD. The reading direction of the LCD can be rotated by 180°.

To configure the positioner with SAMSON's TROVIS-VIEW software, the positioner is equipped with an additional digital interface to be connected to the RS-232 or USB interface of a PC.

All parameters can be accessed using HART® communication.

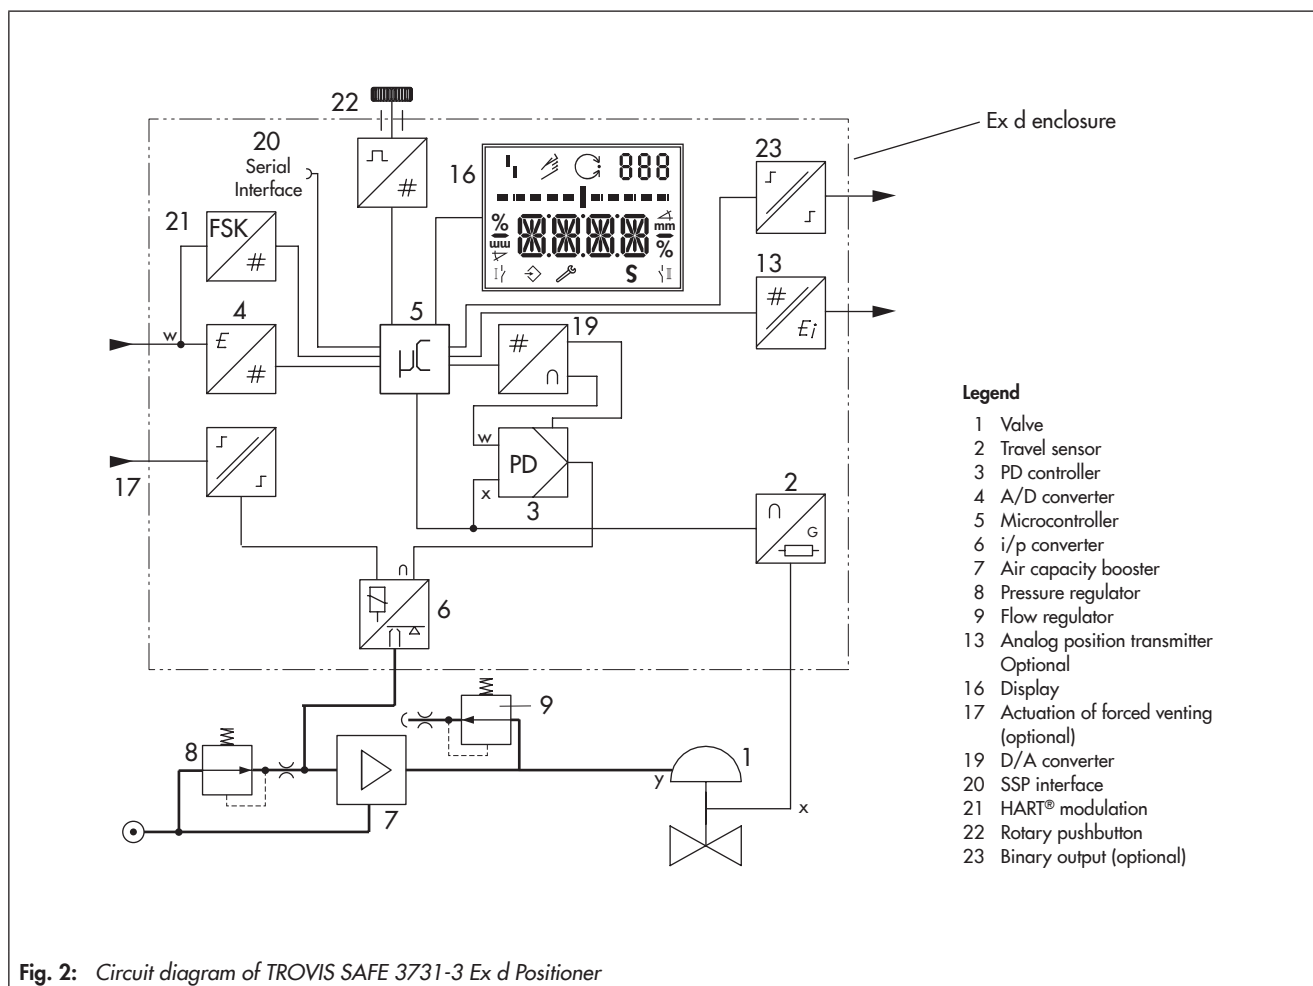






Fig. 2: Circuit diagram of TROVIS SAFE 3731-3 Ex d Positioner

**Table 1: Technical data**

<b>TROVIS SAFE 3731-3 Positioner (technical data in test certificate additionally apply to explosion-protected devices)</b>		
Rated travel	Adjustable	Direct attachment to Type 3277 Actuator: 3.6 to 30 mm Attachment according to IEC 60534-6-1: 3.6 to 300 mm Rotary actuators: 24 to 100° opening angle
Travel range	Adjustable	Adjustable within the initialized travel/angle of rotation; travel can be restricted to 1/5 at the maximum
Set point w	Signal range	4 to 20 mA · Two-wire device, reverse polarity protection · Minimum span 4 mA
	Static destruction limit	40 V · Internal current limit 60 mA
Use in safety-instrumented systems according to IEC 61508		Suitable for use in safety-instrumented systems up to SIL 2 (single device) and SIL 3 (with redundant configuration) TROVIS SAFE 3731-3xxxxx1...: Emergency shutdown at set point $\leq 3.85 \text{ mA} \pm 0.05 \text{ mA}$
Minimum current		3.6 mA for display · Load impedance $\leq 9 \text{ V}$ corresponding to $450 \Omega$ at 20 mA
<b>Communication</b>		
Local communication		SAMSON SSP interface and serial interface adapter
Software requirements (SSP)		TROVIS-VIEW with database module 3731-3
HART® communication		HART® field communication protocol Impedance in HART® frequency range: Receiving approx. $455 \Omega$ · Sending approx. $185 \Omega$
Software requirements (HART®)	For handheld communicator	Device description for TROVIS SAFE 3731-3
	For PC	DTM file certified according to specification 1.2, suitable for integrating the device into frame applications that support the use of FDT/DTM (e.g. PACTware); Integration into AMS™ Suite available
Supply air		TROVIS SAFE 3731-321, TROVIS SAFE 3731-327: 1.4 to 7 bar (20 to 105 psi) TROVIS SAFE 3731-323: 1.4 to 6 bar (20 to 90 psi)
	Air quality acc. to ISO 8573-1 (2004 edition)	Maximum particle size and density: Class 4 · Oil content: Class 3 Pressure dew point: Class 3 or at least 10 K below the lowest ambient temperature to be expected
Signal pressure (output)		0 bar up to the capacity of the supply pressure · Can be limited to 1.4 bar/2.4 bar/3.7 bar $\pm 0.2 \text{ bar}$ by software
Characteristic		Linear/equal percentage/reverse equal percentage Butterfly valve, rotary plug valve or segmented ball valve: linear/equal percentage User-defined: adjustable over operating software
	Deviation	$\leq 1 \%$
Hysteresis		$\leq 0.3 \%$
Sensitivity		$\leq 0.1 \%$
Transit time		Venting or filling with air adjustable separately up to 240 s by software
Direction of action		Reversible
Air consumption	Steady state	Independent of supply air approx. $110 \text{ l}_n/\text{h}$
Air output capacity	Actuator (supply)	At $\Delta p = 6 \text{ bar}$ : $8.5 \text{ m}_n^3/\text{h}$ · At $\Delta p = 1.4 \text{ bar}$ : $3.0 \text{ m}_n^3/\text{h}$ · $K_{V_{\max}(20^\circ\text{C})} = 0.09$
	Actuator (exhaust)	At $\Delta p = 6 \text{ bar}$ : $14.0 \text{ m}_n^3/\text{h}$ · At $\Delta p = 1.4 \text{ bar}$ : $4.5 \text{ m}_n^3/\text{h}$ · $K_{V_{\max}(20^\circ\text{C})} = 0.15$
Permissible ambient temperature		$-40$ to $+80 \text{ }^\circ\text{C}$ · The limits in the test certificate additionally apply.
Permissible storage temperature		$-60$ to $+80 \text{ }^\circ\text{C}$
Influences	Temperature	$\leq 0.2 \%$ /10 K
	Supply air	None
	Effect of vibration	$\leq 0.25 \%$ up to 2000 Hz and 4 g according to IEC 770
Electromagnetic compatibility		Complying with EN 61000-6-2, EN 61000-6-3, EN 61326-1 and NAMUR Recommendation NE 21
Electrical connections		Two tapped holes $\frac{1}{2}$ NPT or optionally M20x1.5 · Screw terminals for $2.5 \text{ mm}^2$ wire cross-section
Degree of protection		IP 66/NEMA 4X
Compliance		

TROVIS SAFE 3731-3 Positioner (technical data in test certificate additionally apply to explosion-protected devices)		
<b>Explosion protection</b>		
	See Table 2	
<b>Materials</b>		
Enclosure	Die-cast aluminum EN AC-ALSi10Mg (Fe) (EN AC-43400) acc. to DIN 1706 Chromated and powder paint coated	
External parts	Stainless steel 1.4301/1.4305/1.4310	
Weight	Approx. 2.5 kg	
<b>Optional binary output</b>	Software limit contact or fault alarm output galvanically isolated Optionally NAMUR (EN 60947-5-6) or PLC	
Signal state	Terminals B-C	Terminals A-B
	Switching output AC/DC (PLC)	
	Conducting/residual voltage < 1.7 V	Non-conducting/≥ 2.2 mA
	Non-conducting/high resistance, I < 100 µA	Conducting/≤ 1.0 mA
Operating voltage	Switching capacity: 40 V DC/28 V AC/0.3 A Static destruction limit: 45 V DC/32 V AC/0.4 A	Only for connection to NAMUR switching amplifier acc. to EN 60947-5-6
<b>Optional binary input</b>	Galvanically isolated · Configurable switching behavior	
Active switching behavior		
Connection	For external switch (floating contact)	
Electric data	Open-circuit voltage when contact is open: max. 10 V · Pulsed DC current reaching peak value of 100 mA	
Contact	Closed	ON switching state
	Open	OFF switching state
Passive switching behavior		
Connection	For externally applied DC voltage, reverse polarity protection	
Electric data	0 to 24 V, static destruction limit 40 V, input resistance 6.5 kΩ	
Voltage	> 6 V	ON switching state
	< 4 V	OFF switching state
<b>Optional forced venting</b>	Galvanic isolation	
Input	0 to 40 V DC/0 to 28 V AC, static destruction limit 45 V DC/32 V AC, input resistance ≥ 7 kΩ	
Signal	Fail-safe position at input voltage < 3 V	Normal operation at input voltage > 5.5 V
<b>Optional analog position transmitter</b>	Two-wire transmitter	
Power supply	11 to 35 V DC, reverse polarity protection, static destruction limit 45 V DC	
Output signal	4 to 20 mA	
Operating direction	Reversible	
Operating range	-1.25 to 103 % of the travel range, corresponding to 3.8 to 20.5 mA Optionally also for fault alarm indication over 2.4 or 21.6 mA according to NAMUR Recommendation NE 43	
Characteristic	Linear	
Hysteresis and high-frequency influence	Same as positioner	
Other influences	Same as positioner	

**Table 2: Explosion protection certificates**

TROVIS SAFE	Certification		Type of protection/comments	
3731	 EC type examination certificate	Number	PTB 11 ATEX 1014 X	II 2G Ex db IIC T6 Gb, II 2G Ex db eb IIC T6 Gb II 2G Ex db [ia Ga] IIC T6 Gb II 2G Ex ia IIC T6 Ga II 2D Ex tb IIIC T80°C DB
		Date	2019-04-08	
		On request		
	CCoE	Number	A P HQ MH 104 6238	Ex d IIC T6
		Date	2018-07-01	
		Valid until	2023-12-31	
	IECEX	Number	IECEX PTB 11.0084X	Ex d IIC T6, T5, T4 Gb; Ex d e IIC T6, T5, T4 Gb; Ex tb IIIC T80°C Db IP66
		Date	2011-09-14	
	INMETRO	No.	IEx 13.0193X	Ex d IIC T* Gb; Ex de IIC T* Gb
		Date	2016-08-28	
Valid until		2022-08-27		
KCS	Number	13-KB4BO-0036	Ex d IIC T6/T5/T4	
	Date	2013-01-31		
	Valid until	2020-01-31		
NEPSI	Number	GYJ16.1083X	Ex d IIC T6~T4; Ex de IIC T6~T4	
	Date	2016-01-24		
	Valid until	2021-01-23		
STCC	Number	ZETC/21/2018	1 Ex d IIC T4...T6; 1 Ex de IIC T4...T6	
	Date	2018-04-27		
	Valid until	2021-04-26		
-323	CSA	Number	1709815	Class I, Zone 1, Group IIB+H2 T4...T6; Class I, Div. 1+2, Groups B, C, D T4...T6; Class II, Div. 1, Groups E, F, G
		Date	2005-10-04	
-324	FM	Number	3024956	Class I, Div. 1+2, Groups B, C, D; Class I, Zone 1, Groups IIB+H2; Class I, Div. 1+2 Groups E, F, G; Class III
		Date	2006-01-30	
-324		On request		
-327	JIS	Number	TC17747	Ex d IIC T6
Date		2018-09-12		
Valid until		2021-09-11		

### Mounting the positioner

The TROVIS SAFE 3731-3 Positioner can be attached directly to the Type 3277 Actuator, to valves with cast yokes or rod-type yokes according to IEC 60534-6 (NAMUR) or to rotary actuators according to VDI/VDE 3845.

Required mounting parts and accessories are listed in the Mounting and Operating Instructions ► EB 8387-3S.

#### Direct attachment

The positioner can be attached directly to the Type 3277 Actuator over a connection block. In actuators with fail-safe action "actuator stem extends" and Type 3277-5 Actuator (120 cm<sup>2</sup>), the signal pressure is routed over an internal hole in the actuator yoke to the actuator. In actuators with fail-safe action "actuator stem retracts" and in actuators with effective diaphragm areas of 240 cm<sup>2</sup> or larger, the signal pressure is routed to the actuator over ready-made external piping.

#### Attachment according to IEC 60534-6 (NAMUR)

The positioner is mounted according to IEC 60534-6-1 and NAMUR recommendation using a NAMUR bracket on the yoke of the valve. The positioner can be mounted on either side of the valve.

#### Attachment to rotary actuators

The positioner must be fitted with an adapter housing and spacers to attach it to rotary actuators according to VDI/VDE 3845.

Another common mounting kit suitable for SAMSON Type 3278 Rotary Actuator and VETEC Types S160 and R Actuators is available.


### Ordering text

TROVIS SAFE 3731-3... Positioner


- With pneumatic connecting rail ISO 228/1-G ¼
- Without/with pressure gauge for signal pressure indication
- Attachment to Type 3277 Actuator (120 to 700 cm<sup>2</sup>)
- Attachment according to IEC 60534-6-1 (NAMUR)
- Travel: ... mm, if applicable, rod diameter: ... mm
- Attachment to Type 3278 Rotary Actuator (160 cm<sup>2</sup>)
- Attachment to rotary actuators according to VDI/VDE 3845
- Pneumatic reversing amplifier for double-acting actuators with connection acc. to ISO 228/1-G ¼ or ¼-18 NPT

**Dimensions in mm**


**Direct attachment**

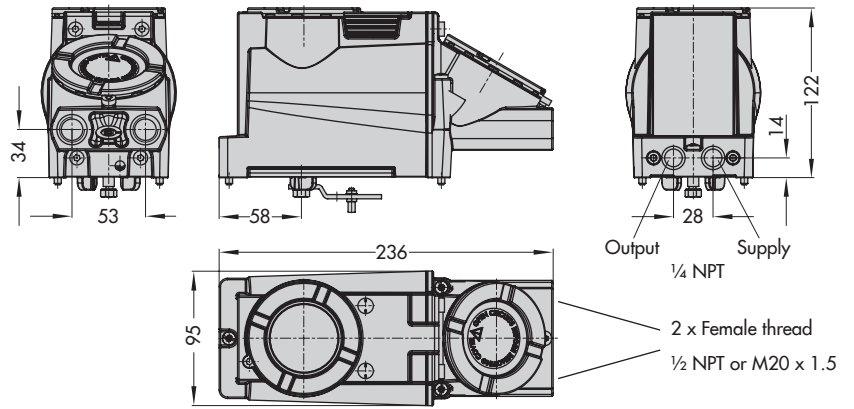

**Attachment according to IEC 60534-6 and NAMUR**


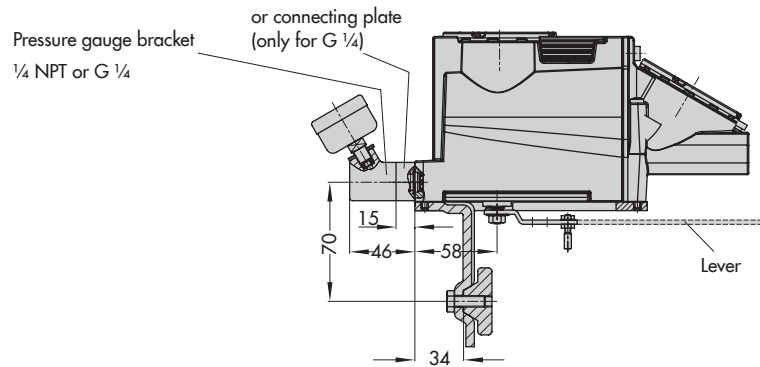


**Attachment to rotary actuators**

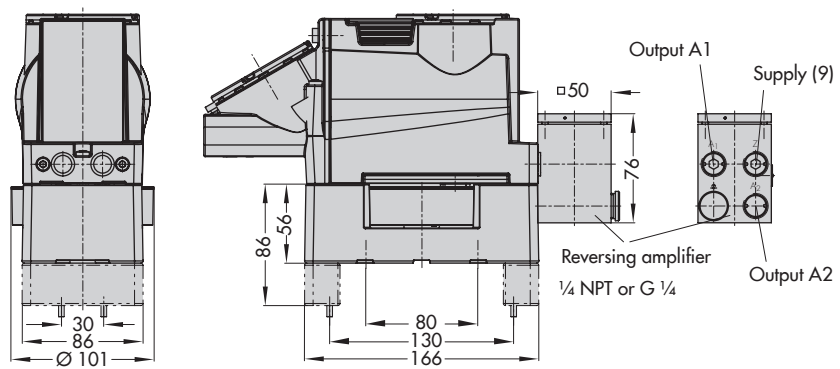

**Lever**

Lever	x	y	z
S	17 mm	25 mm	33 mm
M	25 mm	50 mm	66 mm
L	70 mm	100 mm	116 mm
XL	100 mm	200 mm	216 mm



**Article code**

Positioner	TROVIS SAFE 3731- 3	x	x	x	x	x	x	x	0	0	x	1	x	0	0	0
With LCD, autotune, HART® communication																
Explosion protection																
<b>ATEX</b>	II 2G Ex db IIC T6 Gb, II 2G Ex db eb IIC T6 Gb II 2G Ex db [ia Ga] IIC T6 Gb II 2G Ex ia IIC T6 Ga II 2D Ex tb IIIC T80°C DB IP6	2	1													
<b>FM</b>	Class I, Zone 1, Group IIB+H2 T4...T6; Class I, Div. 1+2, Groups B, C, D T4...T6; Class II, Div. 1, Groups E, F, G	2	3													
<b>CSA</b>	Class I, Zone 1, Group IIB+H2 T4...T6; Class I, Div. 1+2, Groups B, C, D T4...T6; Class II, Div. 1, Groups E, F, G															
<b>EAC Ex</b>	On request	2	4													
<b>JIS</b>	Ex d IIC T6	2	7													
Options																
Without																
	Position transmitter			0	0											
	Binary input			0	3											
	Forced venting			0	5											
	Binary output (NAMUR/PLC)			0	6											
Diagnostics																
EXPERTplus for TROVIS SAFE																
								5								
Electrical threaded connections																
	2x M20x1.5							1								
	2x ½ NPT							2								
Emergency action																
	Emergency shutdown at 0 mA (no longer available)							0								
	Emergency shutdown at a set point lower than 3.85 mA							1								
Explosion protection certificate																
As specified in Table 2																
<b>NEPSI</b>	Ex d IIC T6~T4; Ex de IIC T6~T4 (on request)	2	1									0				
<b>IECEx</b>	Ex d IIC T6, T5, T4 Gb; Ex d e IIC T6, T5, T4 Gb; Ex tb IIIC T80°C Db IP66	2	1									2				
<b>EAC Ex</b>	On request	2	1									3				
Special applications																
Without																
	Version compatible with paint (IP 41/NEMA 1)												0			
													1			
Special version																
Without																
														0	0	0